



NON-HAZARDOUS
AREA

CLASS I DIVISION 2
AREA

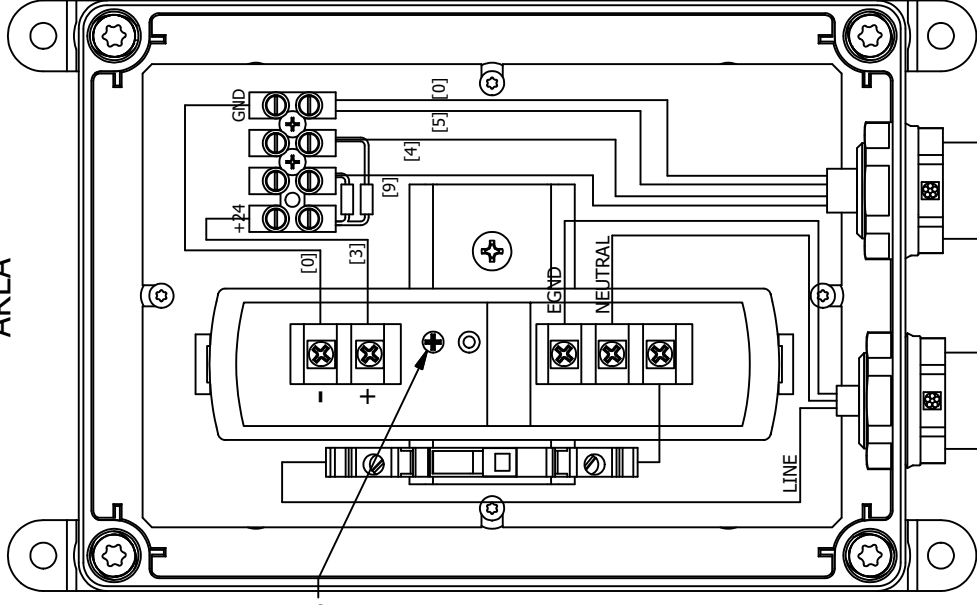

CUSTOMER SUPPLIED
CONDUIT FITTING

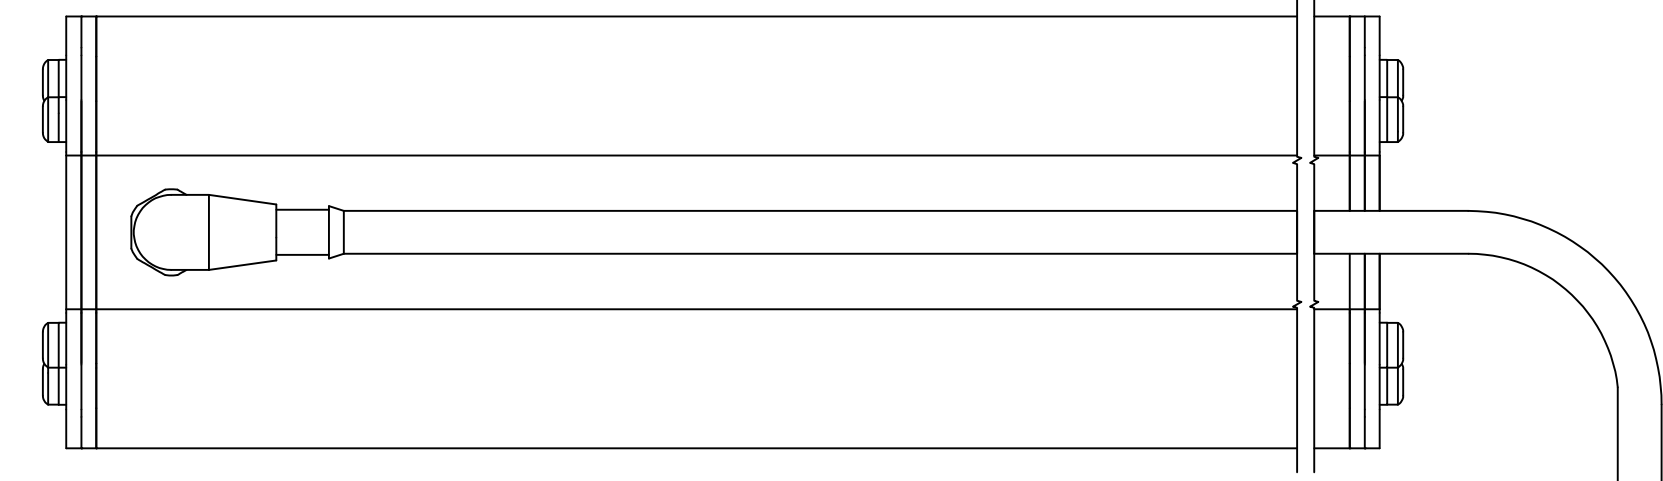

CUSTOMER SUPPLIED
AC VOLTAGE (Um)

EGND
NEUTRAL
LINE

SIMPLIPOINT 180 MODEL CODE:
RPWAI #S HL

POWER SUPPLY OUTPUT VOLTAGE

LED SUB-ASSEMBLY P/N	OUTPUT VOLTAGE
RPWAI 5S HL	22.00 VDC (SEE NOTE 6)
RPWAI 6S HL	22.75 VDC (SEE NOTE 6)
RPWAI 7S HL	24.75 VDC (SEE NOTE 6)
RPWAI 8S HL	27.75 VDC (SEE NOTE 6)
RPWAI 9S HL	27.50 VDC (SEE NOTE 6)
RPWAI 10S HL	28.50 VDC (SEE NOTE 6)

SPECIFICATIONS
POWER SUPPLY:

85 - 264 VAC @ 47-63 (Um), 1.5A MAX

APPROVALS:

CLASS I, DIV 2, GROUPS A,B,C,D T4 Ta = 176°F (80°C)
ASSOCIATED EQUIPMENT [Exia]

AMBIENT TEMP.:

-13°F/+25°C ≤ Ta ≤ 176°F/80°C

WIRE SIZE:

MIN 20 AWG/ MAX 12 AWG (MIN 0.52mm²/ MAX 3.3mm²)

ELECTRICAL CONN.:

ENCLOSURE SUPPLIED WITH .875" THRU HOLE FOR 1/2"
CONDUIT CONNECTION.

ELECTRICAL RATING:

Vmax = 30VDC, Imax = 2.5A

- NOTES:
- 1) ALL NATIONAL AND LOCAL CODES AND REGULATIONS MUST BE ADHERED TO WHEN INSTALLING THE ILLUMINATOR IN A HAZARDOUS ENVIRONMENT.
 - 2) THE MAXIMUM NONHAZARDOUS LOCATION VOLTAGE SHALL NOT EXCEED THE Um OF THE ASSOCIATED APPARATUS.
 - 3) NO SUBSTITUTION OF COMPONENTS. TO PREVENT IGNITION OF FLAMMABLE ATMOSPHERES, DISCONNECT POWER BEFORE SERVICING.
 - 4) WARNING: THE EQUIPMENT CONTAINS NON-METALLIC ENCLOSURE PARTS, TO PREVENT THE RISK OF ELECTROSTATIC SPARKING, THE NON-METALLIC SURFACE SHOULD ONLY BE CLEANED WITH A DAMP CLOTH.
AVERTISSEMENT : L'EQUIPEMENT CONTIENT DES NON METALLIQUES BOTTIER PARTIES, DE PREVENIR LET RISQUE D' TINSELLED ELECTROSTATIQUES, LA SURFACE NON METALLIQUE DOIT ETRE NETTOYEE QU'AVEC UN CHIFFON HUMIDE.
 - 5) ALL WIRING IS MINIMUM 20 AWG, WITH A MINIMUM RATING OF 600V, -40°C TO 105°C.
 - 6) OUTPUT VOLTAGE IS FACTORY SET. VOLTAGE OUTPUT ADJUSTMENT SCREW IS SEALED WITH SILICONE. IF SILICONE IS TAMPERED WITH WARRANTY IS VOID.
 - 7) # IN PART NUMBER DENOTES NUMBER OF PORTS (5-10).
 - 8) [#] DENOTES EIA COLOR CODE.
 - 9) POWER SUPPLY GROUND NEEDS TO BE CONNECTED TO A SAFETY EARTHING GROUND SYSTEM.
 - 10) AGENCY CONTROLLED DOCUMENT.

MANUFACTURED BY
Clark-Reliance®
16633 FOLTZ PARKWAY
STRONGSVILLE, OH 44149 USA
(440) 572-1500 | www.clarkreliance.com
© Clark-Reliance® Corporation. All Rights Reserved.

RELIANCE®

**CONTROL AND INSTALLATION,
SIMPLIPOINT 180, LOCAL
CLASS I DIVISION 2**

REV	DATE	NEW RELEASE	REVISION
0	12/19/2018		

PART NUMBER: **CI 7409**

TOLERANCE CLASS (PER PES-004): N/A

MATERIAL: N/A

REVISION: 0 PER CDC-18-534 SH 12/19/2018

DRAWN: RAC

CHECKED: SRM

DATE: 5/21/2019

REV.:

DRAWING NO.:

CI-7409

THIS DRAWING CONTAINS MATERIAL THAT IS CONFIDENTIAL AND/OR PRIVILEGED FOR THE SOLE USE OF THE INTENDED RECIPIENT. ANY REVIEW, REUSE OR DISTRIBUTION BY OTHERS OR FORWARDING WITHOUT EXPRESS PERMISSION IS STRICTLY PROHIBITED.