
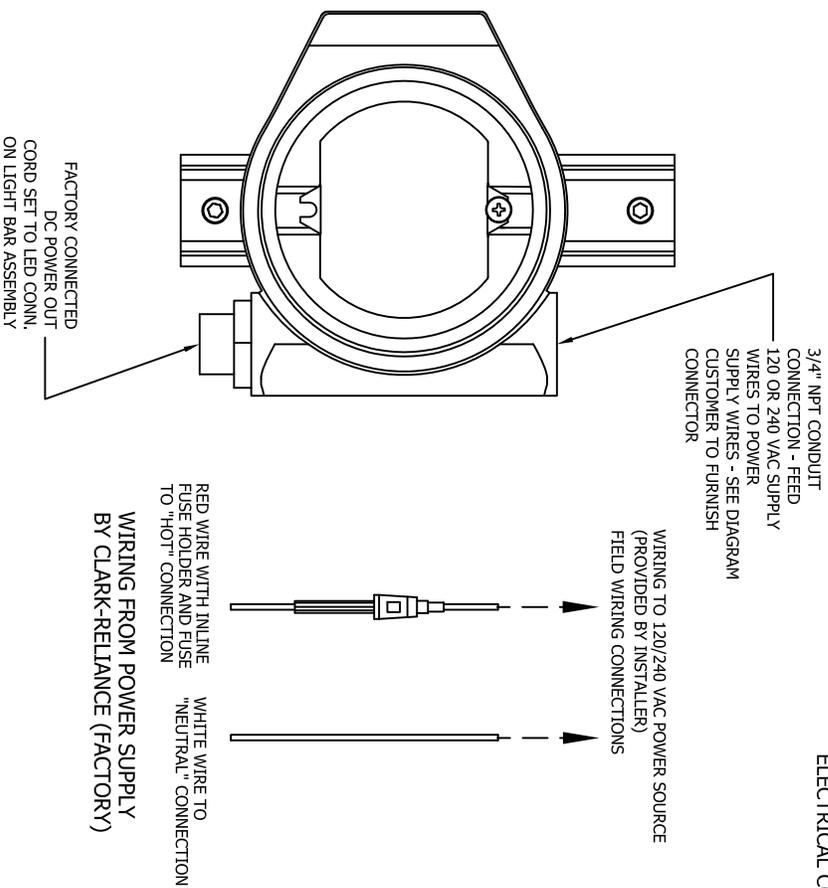



NOTE: ALL FIELD WIRING IS TO BE DONE BY A QUALIFIED ELECTRICIAN IN ACCORDANCE WITH ALL APPLICABLE ELECTRICAL CODES AND ORDINANCES.

POWER SUPPLY CAN BE REMOVED FROM LIGHT BAR AND MOUNTED REMOTELY.

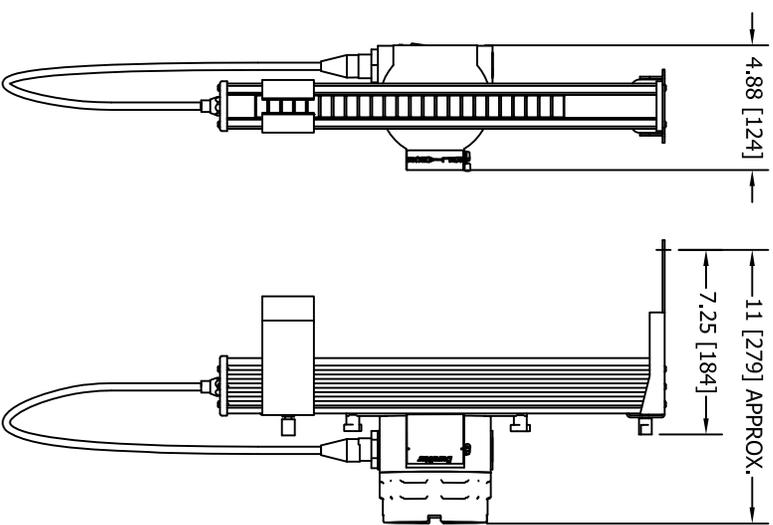

**SPECIFICATIONS**

POWER SUPPLY: 100-240 VAC @ 50/60 HZ  
 POWER CONSUMPTION: <320MA @ 100 VAC  
 EST. LIFE: 100,000 HOURS (CONTINUOUS)  
 AGENCY APPROVALS: FM ORDINARY LOCATIONS  
 CFM ORDINARY LOCATIONS  
 WIRE SIZE: MIN. 18 AWG/MAX. 12 AWG  
 MAX. DIST. FROM POWER SUPPLY TO LIGHT: 72 FT. (22M)  
 AMBIENT TEMPERATURE: -40°F (-40°C) TO 150°F (65°C)  
 ELECTRICAL CONNECTION: 3/4" FNPT

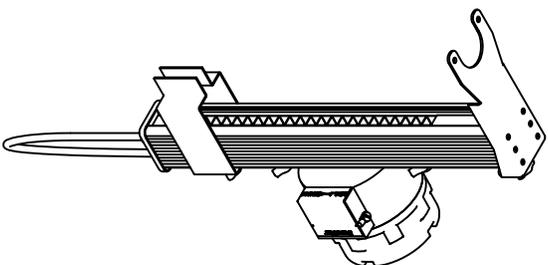

**CLARK-RELIANCE®**

**DURASTAR ILLUMINATOR  
 FOR NON-CLASSIFIED AREAS**

MANUFACTURED BY  
  
**Clark-Reliance®**  
 16633 FOLTZ PARKWAY  
 STRONGSVILLE, OH 44149 USA  
 PH: 440-572-1500  
 WEB: www.clarkreliance.com

PART NUMBER: DS1000-**** *	
TOLERANCE CLASS (PER PDS-004):	
MATERIAL:	
REVISION: DRAWING CREATED	
DRAWN: ER	DRAWING NO.:
CHECKED: JWK	DS1006
DATE: 12/18/13	REV.:
	0